


DRAFT

POOL GAS ELECTRICAL AND COMMUNICATIONS

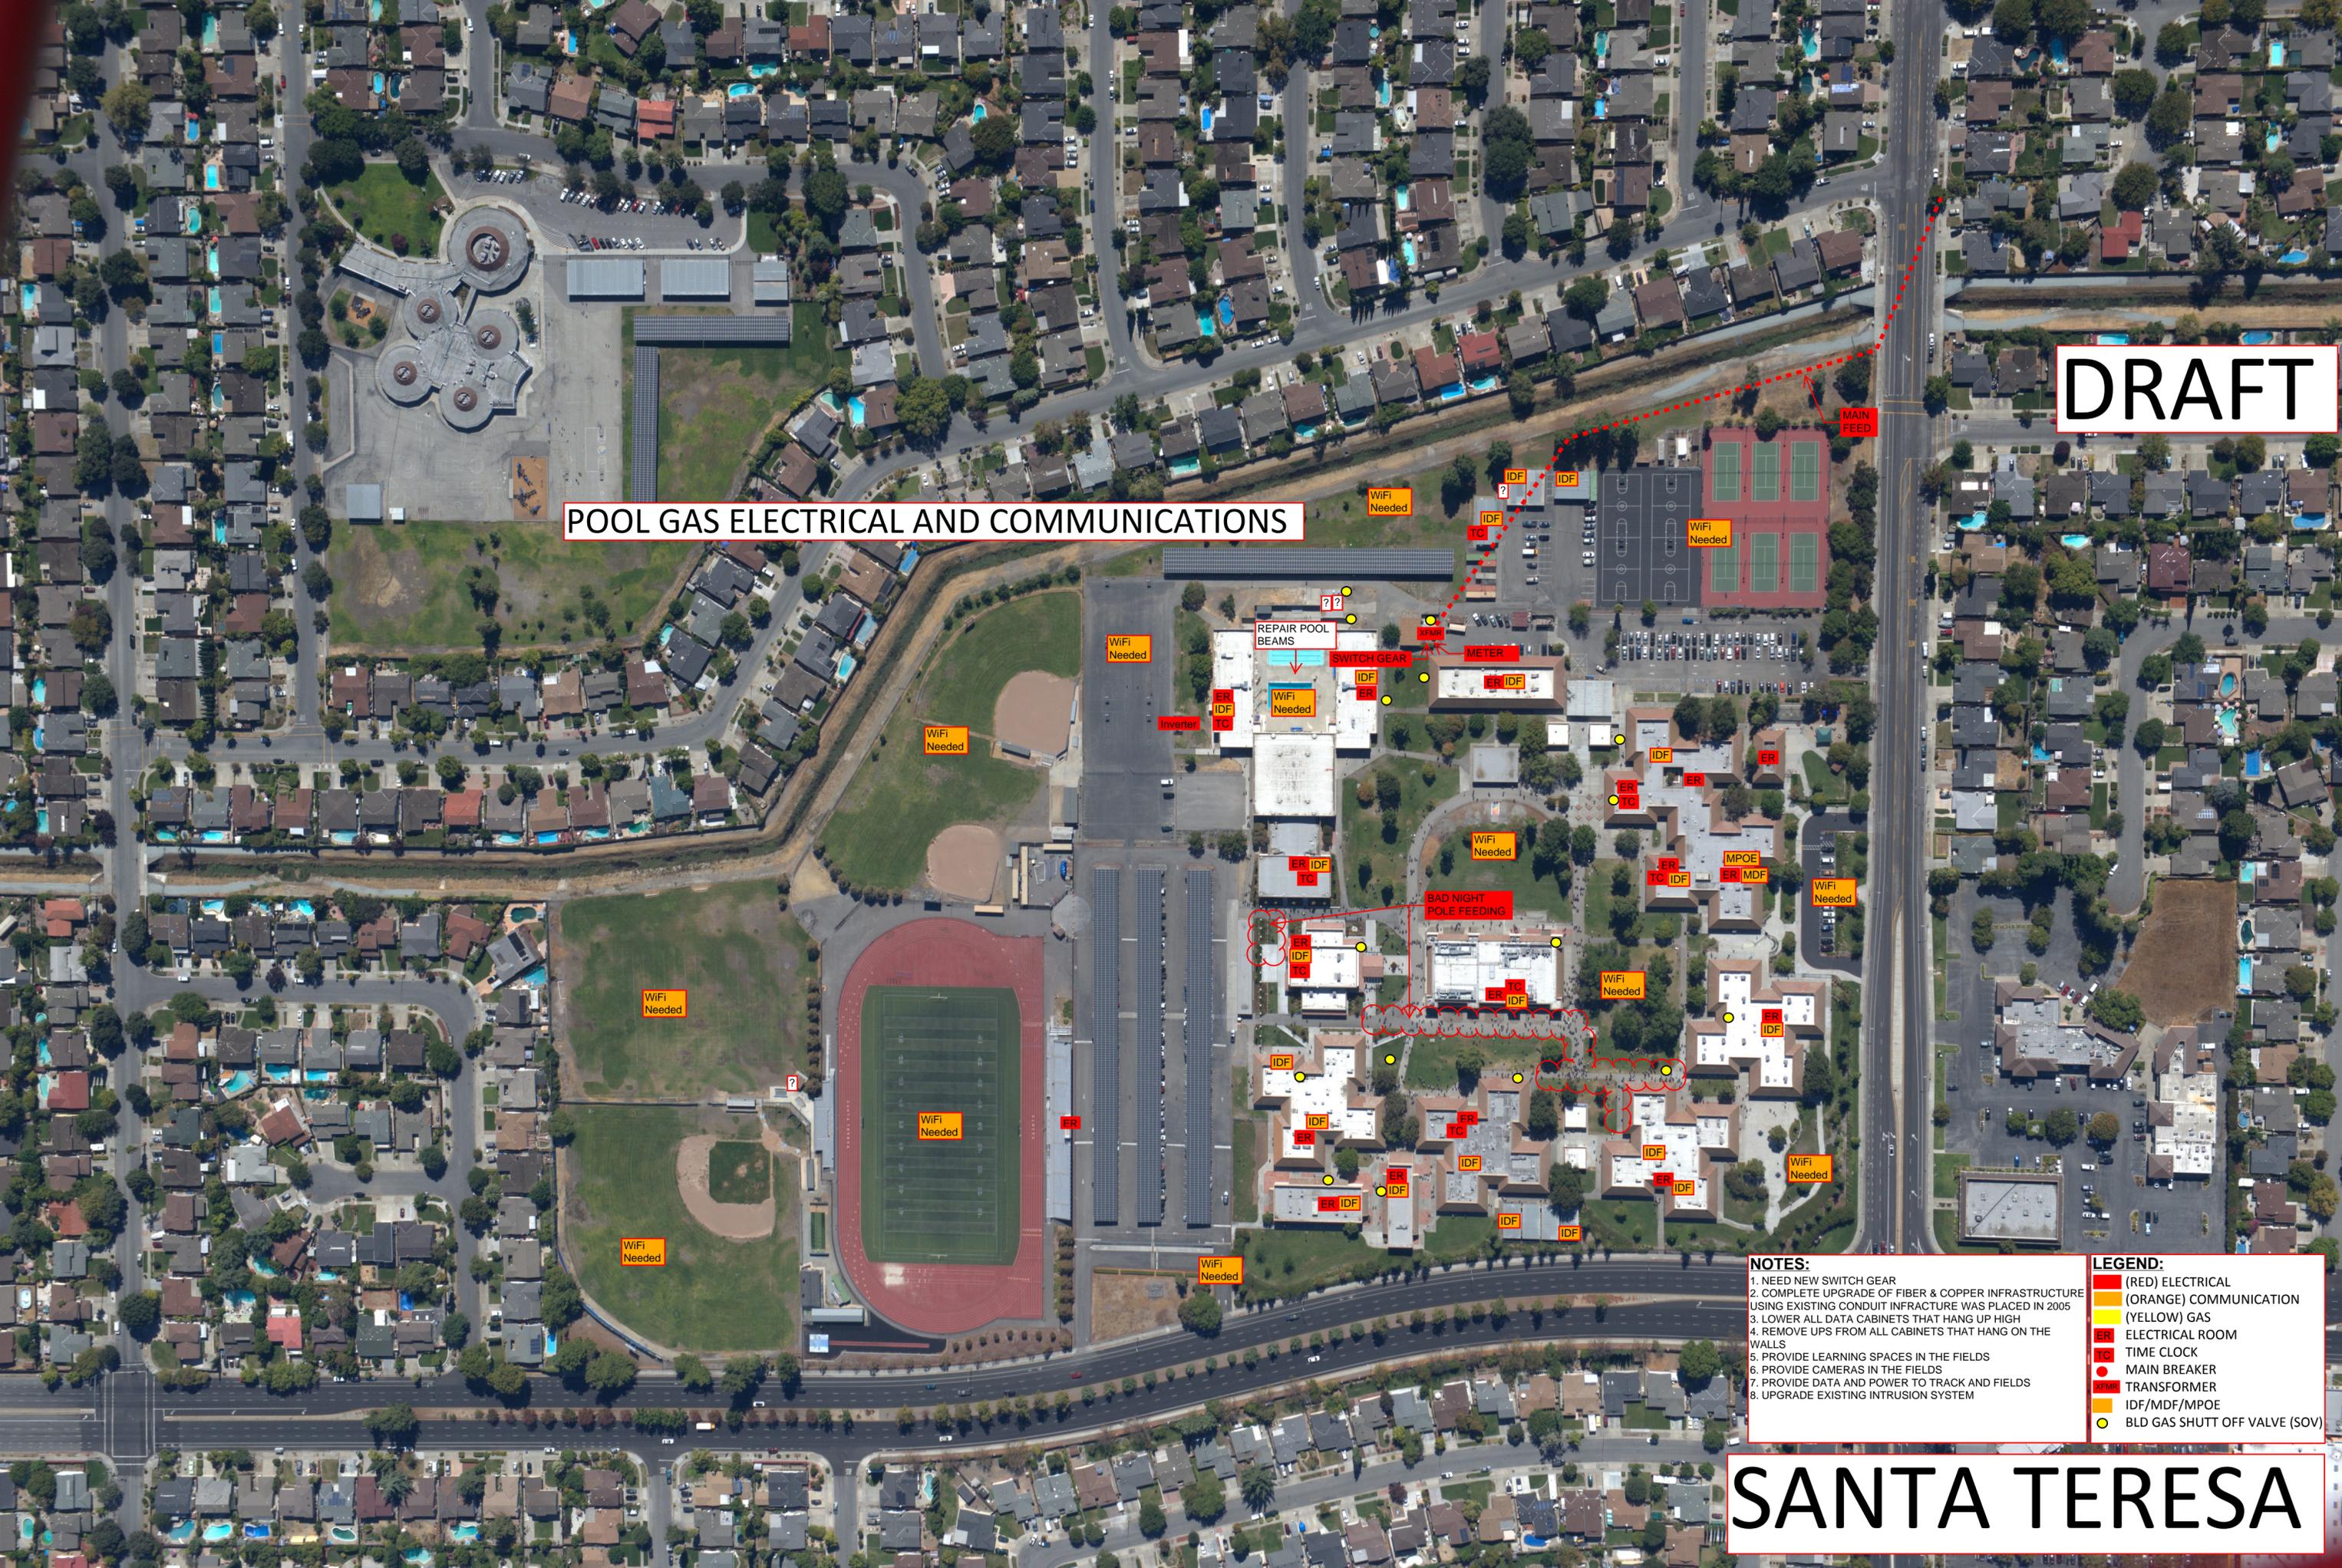

NOTES:

1. NEED NEW SWITCH GEAR
2. COMPLETE UPGRADE OF FIBER & COPPER INFRASTRUCTURE USING EXISTING CONDUIT INFRASTRUCTURE THAT WAS PLACED IN 2005
3. LOWER ALL DATA CABINETS THAT HANG UP HIGH
4. REMOVE UPS FROM ALL CABINETS THAT HANG ON THE WALLS
5. PROVIDE LEARNING SPACES IN THE FIELDS
6. PROVIDE CAMERAS IN THE FIELDS
7. PROVIDE DATA AND POWER TO TRACK AND FIELDS
8. UPGRADE EXISTING INTRUSION SYSTEM

LEGEND:

- (RED) ELECTRICAL
- (ORANGE) COMMUNICATION
- (YELLOW) GAS
- ER ELECTRICAL ROOM
- TC TIME CLOCK
- MAIN BREAKER
- TRANSFORMER
- IDF/MDF/MPOE
- BLD GAS SHUTT OFF VALVE (SOV)

SANTA TERESA